

# COLORTECH - BT

701 West Erie Street Phone 312 666 5500  
Chicago, Illinois 60610 Fax 312 666 8597  
wsflab.com


Laboratory Service Fittings by  
WaterSaver Faucet Co.

BTEW1020

DRENCH HOSE UNIT, DECK MOUNTED, REINFORCED PLASTIC HOSE

BTEW1020BSH

SAME AS BTEW1020 EXCEPT WITH BRAIDED STAINLESS STEEL HOSE

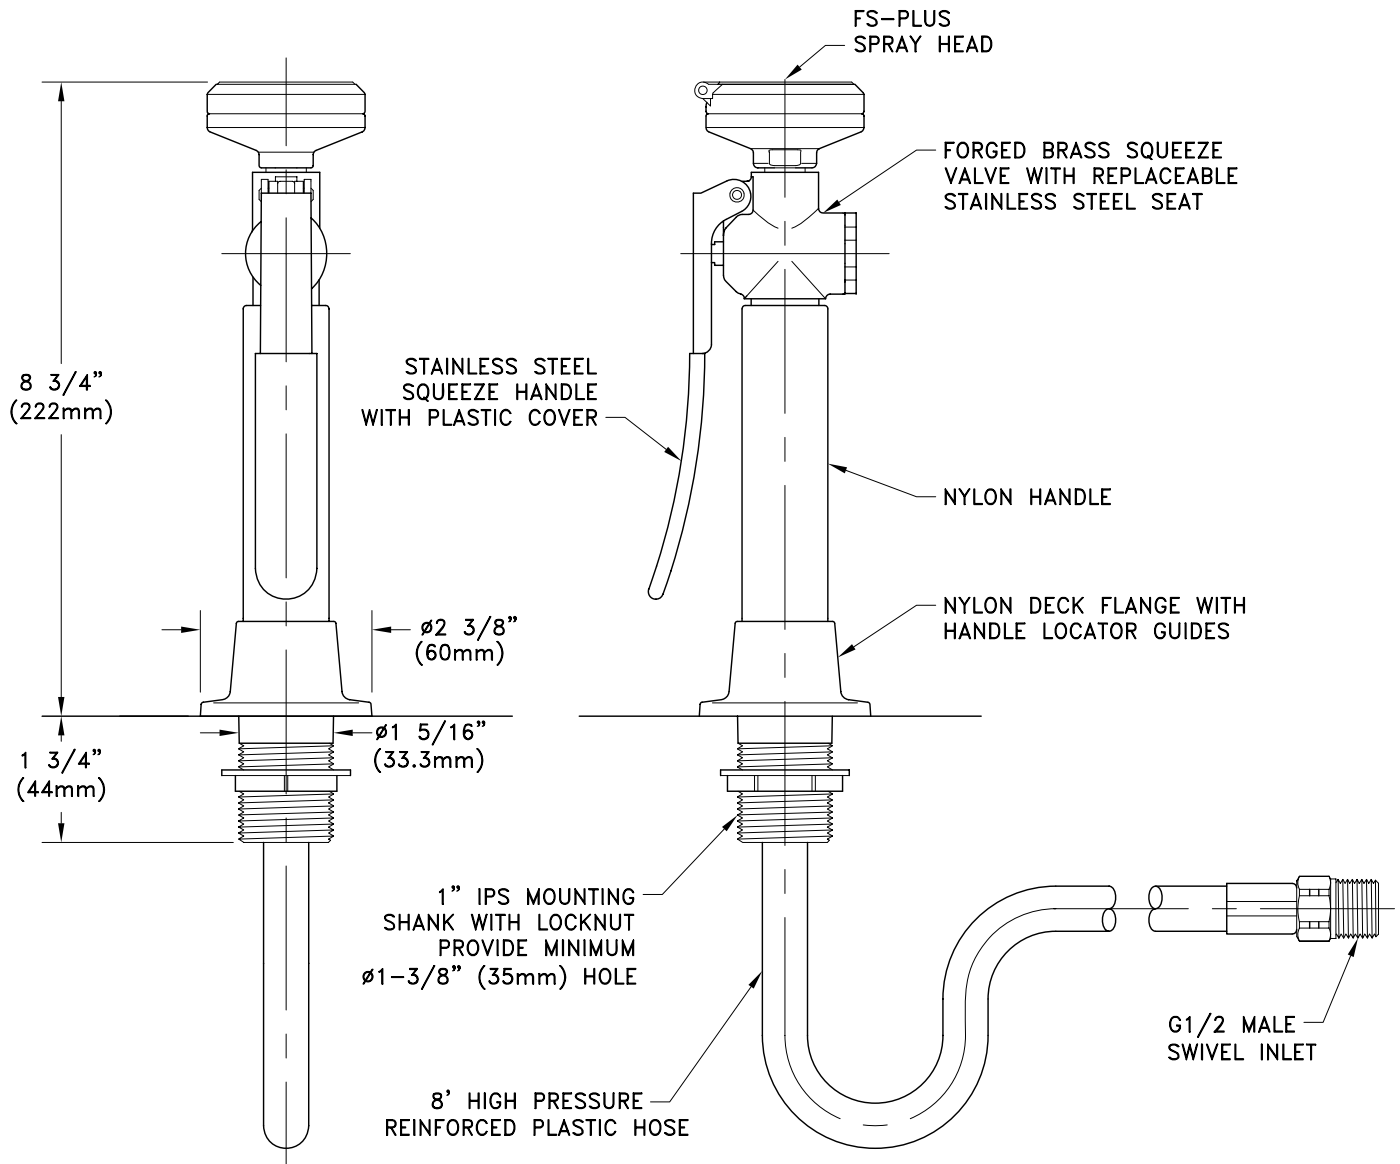

## NOTES:

1. FS-PLUS SPRAY HEAD HAS A "FLIP-TOP" DUST COVER, INTERNAL FLOW CONTROL AND FILTER TO REMOVE IMPURITIES FROM THE WATER FLOW.
2. HOSE SHOULD NOT BE USED IN APPLICATIONS WHERE WATER PRESSURE EXCEEDS 90 PSI. HOSE SHOULD BE INSPECTED PERIODICALLY FOR DETERIORATION.
3. ALL EXPOSED BRASS COMPONENTS ARE FURNISHED WITH COLORTECH POWDER COATING.

UNITS (EXCEPT THOSE WITH SELF-CLOSING VALVES) COMPLY WITH THE REQUIREMENTS OF ANSI Z358.1.

TEST ALL EMERGENCY EQUIPMENT AT LEAST WEEKLY.  
MEASUREMENTS MAY VARY  $\pm 1/4"$  (6mm).

Drawing Number: \_\_\_\_\_

Approved: \_\_\_\_\_

Revision Number: \_\_\_\_\_

111505-KJS