

COLORTECH - BT

701 West Erie Street Phone 312 666 5500
Chicago, Illinois 60610 Fax 312 666 8597
wsflab.com


Laboratory Service Fittings by
WaterSaver Faucet Co.

BTEW1022

EYE WASH/DRENCH HOSE UNIT, DECK MOUNTED, REINFORCED PLASTIC HOSE

BTEW1022BSH

SAME AS BTEW1022 EXCEPT WITH BRAIDED STAINLESS STEEL HOSE

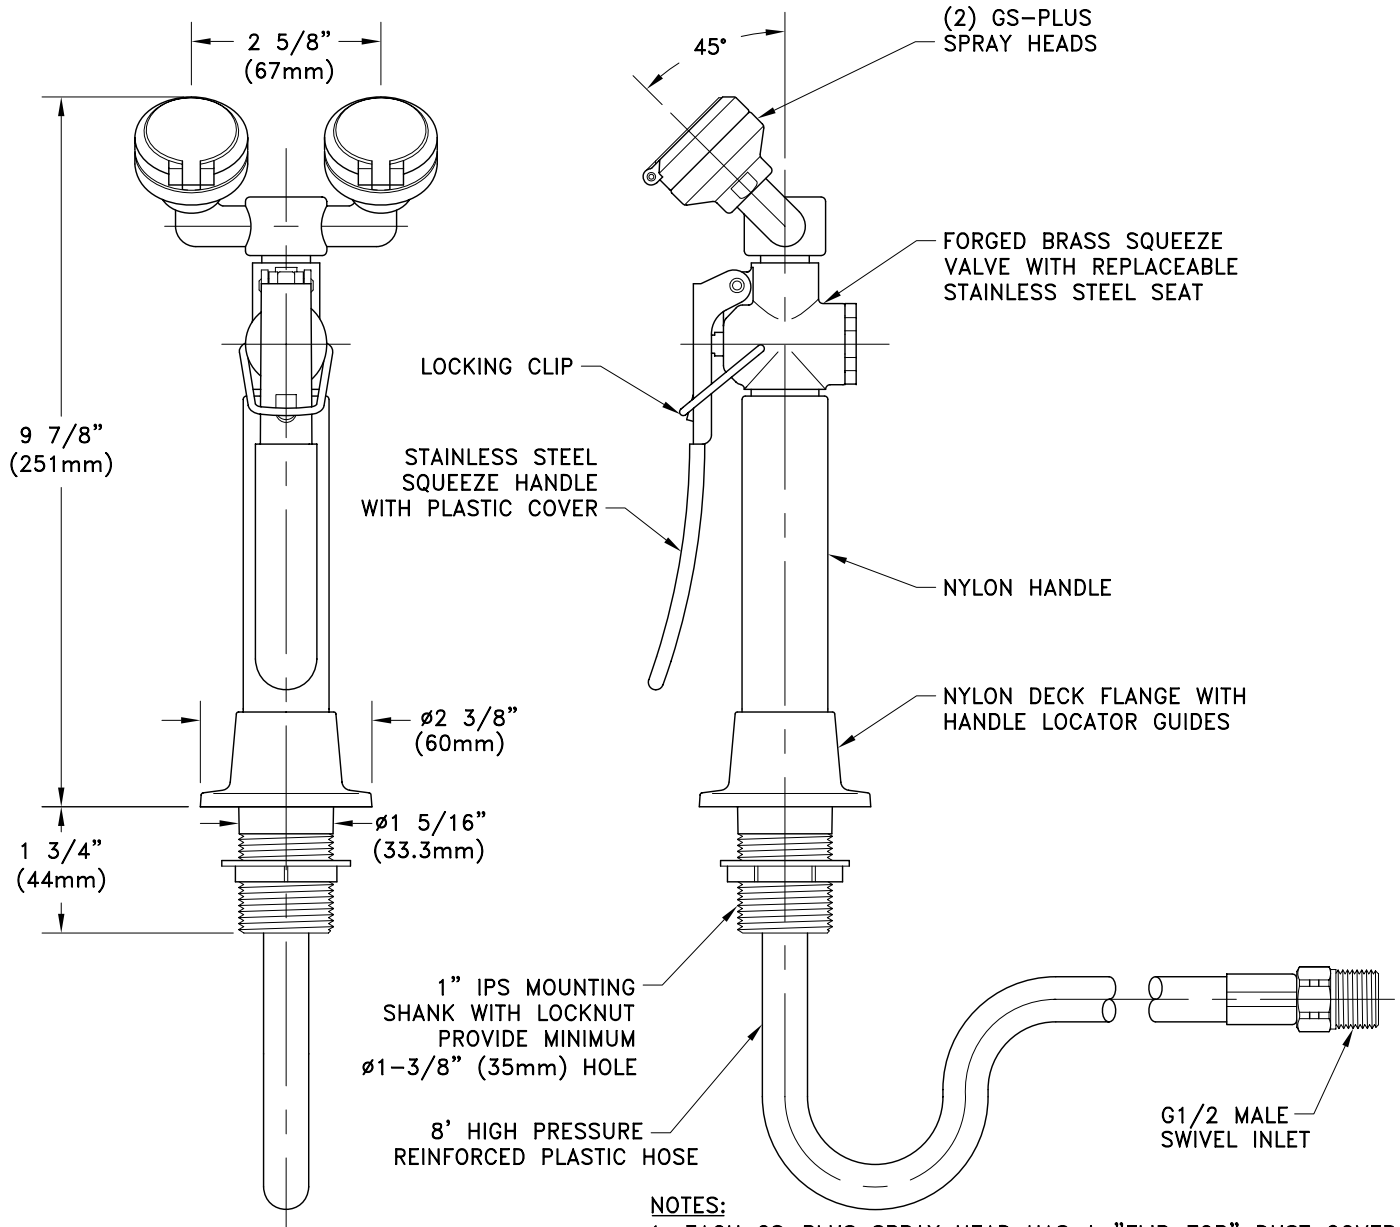

NOTES:

1. EACH GS-PLUS SPRAY HEAD HAS A "FLIP-TOP" DUST COVER, INTERNAL FLOW CONTROL AND FILTER TO REMOVE IMPURITIES FROM THE WATER FLOW.
2. HOSE SHOULD NOT BE USED IN APPLICATIONS WHERE WATER PRESSURE EXCEEDS 90 PSI. HOSE SHOULD BE INSPECTED PERIODICALLY FOR DETERIORATION.
3. ALL EXPOSED BRASS COMPONENTS ARE FURNISHED WITH COLORTECH POWDER COATING.

UNITS (EXCEPT THOSE WITH SELF-CLOSING VALVES) COMPLY WITH THE REQUIREMENTS OF ANSI Z358.1.

TEST ALL EMERGENCY EQUIPMENT AT LEAST WEEKLY.
MEASUREMENTS MAY VARY $\pm 1/4$ " (6mm).

Drawing Number: _____

Approved: _____

Revision Number: _____

111505-KJS